

WASTEWATER UTILITY REPORT

June 2025

Wastewater Connections

0.09% (4) of 4222 improved parcels are remaining to connect. Those not yet connected are three (3) residential properties and one (1) non-residential properties.


New units constructed after October 2019 are not included in the parcel counts in the chart below.

Wastewater connection for new construction is mandatory before a Certificate of Occupancy is issued.

AREA	Total Parcels	Parcels Connected	% CONNECTED
NPK	1183	1182	99.92%
MPK	691	691	100.00%
SPK/WK	815	814	99.88%
UMK	559	557	99.64%
LMK	974	974	100.00%
TOTALS	4222	4218	99.91%


Monthly Wastewater Flows

The Transfer Pump Station pumped 23,320 million gallons in June 2025.

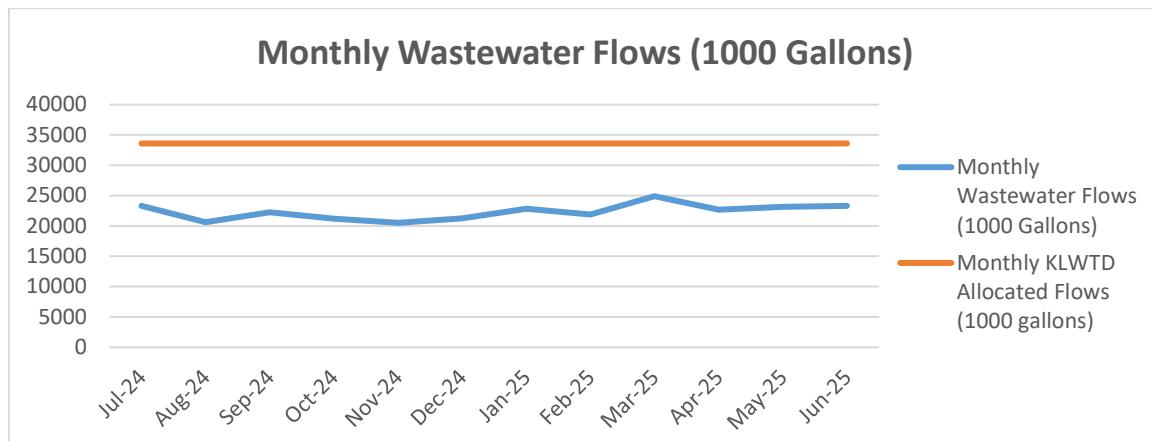

Salinity

Salinity level was within compliance range per the interlocal agreement with KLWTD.

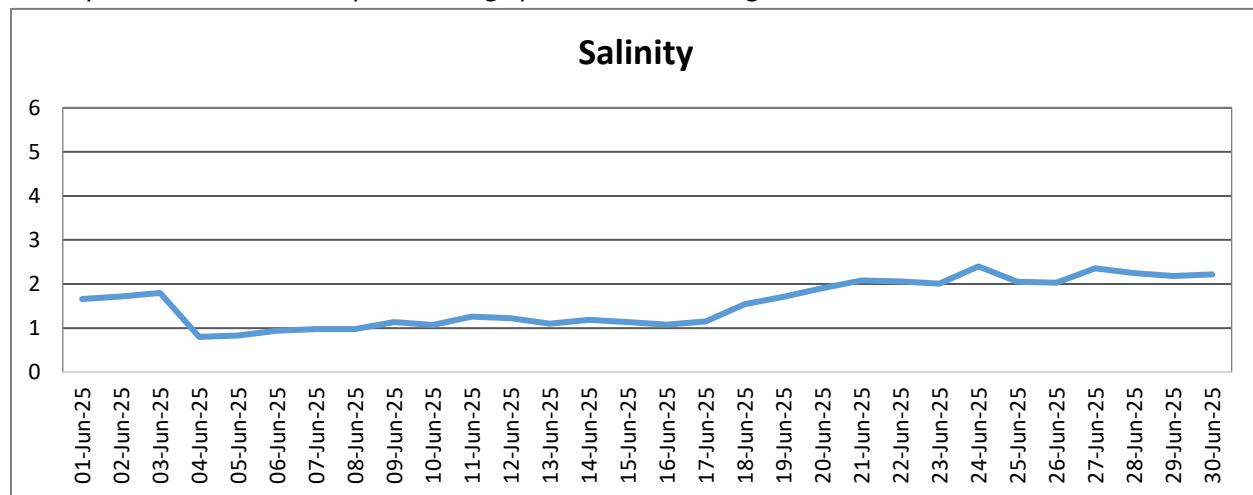

Package Plants not yet connected

63 Plants from Original List

5 Facilities Closed

58 Total Package Plants

56 connected

1 In Progress

1 No progress

2 not connected

as of 7/7/25